

Series 228CB Metallic Tee Type Flow Sensors

DESCRIPTION

The Series 228 flow sensors from Badger Meter® feature a six-bladed impeller design with a proprietary non-magnetic sensing mechanism. The forward swept impeller shape provides higher, more consistent torque than four-bladed impeller designs and is less prone to be fouled by water-borne debris. The forward curved shape coupled with the absence of magnetic drag provides improved operation and repeatability, even at lower flow rates. This is especially true where the impeller is exposed to metallic or rust particles found in steel or iron pipes. As the liquid flow turns the impeller, a low impedance square wave signal is transmitted with a frequency proportional to the flow rate. The signal can travel up to 2000 ft between the flow sensor and the display unit without the need for amplification.

All sensors, except irrigation versions, are supplied with 20 ft of 2-conductor 20 AWG shielded UL type PTLC 221° F (105° C) cable.

MATERIALS

The 228CB tee-mounted flow sensor consists of a 220 brass/bronze sensor mounted in a 2 inch or 2.5 inch cast iron tee.



SPECIFICATIONS

Wetted Materials (except tees)	See "Part Number Construction" on page 3						
Sensor Sleeve and Hex Adapter	Sleeve		Admiralty brass, UNS C44300				
Sensor Sieeve and Hex Adapter	Hex Adapter		Lead-free brass, C89833				
Tee for 228CB	Cast iron, Class 125	per ASN	NE B16.4				
Town austrius Batin na	Standard Version		221° F (105° C) continuous service				
Temperature Ratings	Irrigation Version		150° F (66° C) continuous service				
	Temperature (F) Pressure (psi)						
	-20150	175	175				
Pressure Ratings	200	165					
	250	150					
	300	140					
Recommended Design Flow Range							
Accuracy	±1.0% of full scale over recommended design flow range						
Repeatability	±0.3% of full scale over recommended design flow range for 228						
Linearity	±0.2% of full scale over recommended design flow range for 228						
	Supply voltage = 8V DC min. 35V DC max.						
_	Quiescent current = 600 μA (typical)						
Transducer Excitation	OFF State (V_{High}) = Supply voltage – (600 μ A × Supply impedance)						
	ON State (V _{Low}) = 1.2V DC @ 40 mA (15 Ω + 0.7V DC)						
Electrical Cable for Standard	20 ft (6 m) of 2-conductor 20 AWG shielded UL type PTLC wire provided for connection to display or analog						
Sensor Electronics	transmitter unit. Rated to 221° F (105° C). May be extended to a maximum of 2000 ft (610 m) with similar cable and insulation appropriate for application.						
Electrical Cable for IR Sensor	48 in. (122 cm) of UL Style 116666 copper solid AWG 18 wire with direct burial insulation.						
Electronics	Rated to 221° F (105° C).						



DIMENSIONS

Standard 228CB Sensor

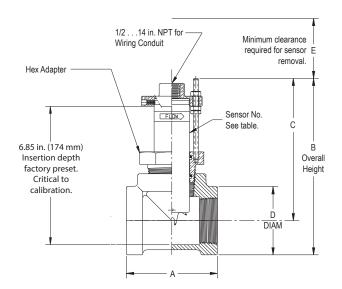


Figure 1: Standard 228CB flow sensor

Series No.	Tee No.	NPT Threads per inch	Α	B*	C*	D	E
228CB-2	71876T	211.5	4.50 in. (114.30 mm)	8.52 in. (216.41 mm)	6.88 in. (174.75 mm)	3.28 in. (83.31 mm)	6 in. (152.4 mm)
228CB-2.5	71881T	2.58	4.80 in. (121.92 mm)	9.16 in. (232.66 mm)	7.23 in. (183.64 mm)	3.86 in. (98.04 mm)	6 in. (152.4 mm)

^{*} Dimensions (B, C) may vary ± 0.25 in., depending on the makeup of the pipe threads.

High Temperature 228CB Sensor

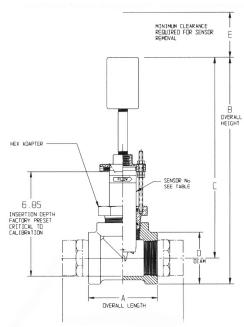



Figure 2: High temperature 228CB flow sensor

Series No.	Tee No.	NPT Threads per inch	A	B*	C*	D	E
228CB-2	71876T	211.5	4.50 in. (114.30 mm)	18.14 in. (460.76 mm)	16.50 in. (419.10 mm)	3.28 in. (83.31 mm)	6 in. (152.4 mm)
228CB-2.5	71881T	2.58	4.80 in. (121.92 mm)	18.18 in. (461.77 mm)	16.25 in. (412.75 mm)	3.86 in. (98.04 mm)	6 in. (152.4 mm)


^{*} Dimensions (B, C) may vary ± 0.25 in., depending on the makeup of the pipe thread.

PART NUMBER CONSTRUCTION

Standard Sensor

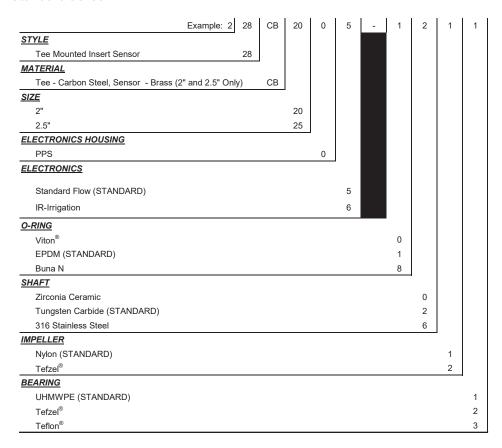

High Temperature Sensor

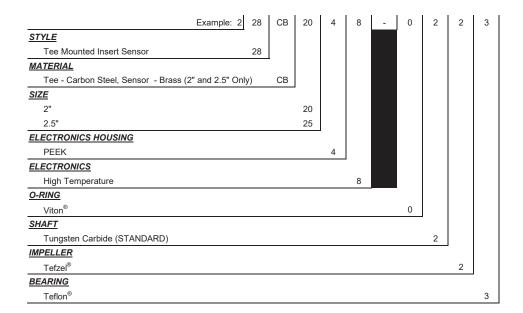



Data Industrial is a registered trademark of Badger Meter, Inc. Other trademarks appearing in this document are the property of their respective entities. Due to continuous research, product improvements and enhancements, Badger Meter reserves the right to change product or system specifications without notice, except to the extent an outstanding contractual obligation exists. © 2020 Badger Meter, Inc. All rights reserved.

www.badgermeter.com